




MAC120-03-N-407 Air-Cooled Chiller

Air-Cooled Chillers for Global Residential
and Light Commercial MicroClimates

MAC120 NOMENCLATURE BREAKDOWN

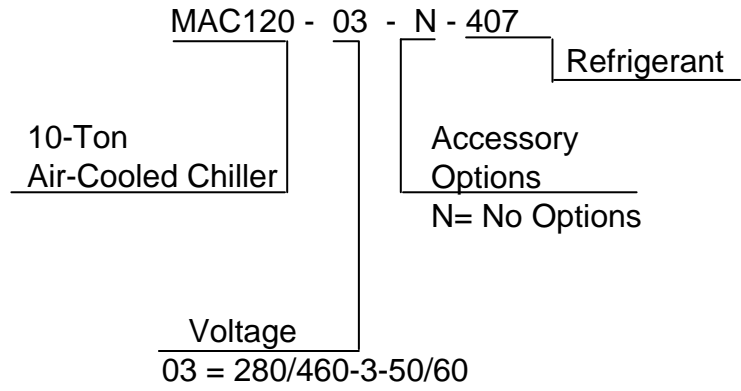

Available Model Numbers
MAC120-03-N-407

HVAC Guide Specifications

Air-Cooled Liquid Chiller

Nominal Size:

10 Tons

MultiAqua Model Number:

MAC120-03-N-407

Part 1-General

1.01 System Description

- A. MultiAqua air-cooled liquid chillers are designed using scroll compressors and low sound condenser fans.
- B. Chiller shall be compatible with alternative heat sources such as Natural Gas, Propane, Oil or Solar for low ambient days.

1.02 Quality Assurance

- A. Certified in accordance with U.L. Standard 95, latest version (U.S.A.)
- B. Manufactured in a facility registered to ISO 9002, Manufacturing Quality Standard.
- C. Construction shall comply with ASHRAE 15 Mechanical Safety Code, NEC and ASME applicable codes. (U.S.A. Codes)
- D. Meets ASHRAE 15 Mechanical Safety Code in regards to refrigerant discharges into occupied spaces.
- E. ETL certified.
- F. Fully load tested at the factory.
- G. Damage resistant packaging.

1.03 Delivery, Storage and Handling

- A. Packaged and readied for shipment from the factory.
- B. Controls shall be capable of withstanding 150°F storage temperatures in the control compartment.
- C. Stored and handled per manufacturer's recommendations.

Part 2-Product

2.01 Equipment

- A. General:
 1. Unit shall be a factory assembled and tested air-cooled liquid chiller.
 2. Shall be assembled on heavy gauge steel mounting/lifting rails.
 3. Contained within the unit cabinet shall be all factory wiring, piping, controls, refrigerant charge (R407c), POE oil and special accessories required prior to start up.
 4. Brass body strainer with 20 mesh screen and blow down shall be supplied in cabinet as a field installable accessory.
 5. System can be easily and without limit be expanded by paralleling and banking chillers together.
- B. Unit Cabinet:
 1. Composed of heavy gauge galvanized steel casing with a baked polyester powder.
 2. Capable of withstanding 500-hour salt spray test in accordance with the ASTM (U.S.A.) standard.
- C. Condenser Fans:
 1. 4-blade, aluminum construction and shall be dynamically balanced and corrosion resistant.
 2. Discharge air at a 45° vertical angle.
 3. Motors and blades shall be protected by coated steel wire safety guards.
- D. Fan Motors:
 1. Condenser fan motors shall be single speed, direct drive.
 2. Totally enclosed.
 3. Permanently lubricated sleeve bearings and Class F insulation.
 4. Internal overload protection.
- E. Compressors:
 1. Unit shall contain two fully hermetic scroll compressors.
 2. Direct-drive, 3500 rpm (60Hz)
 3. Compressor motor shall be suction gas cooled.
 4. Internal motor protection.
 5. Externally protected by low and high pressure cutout devices.
 6. Individual vibration isolators.

F. Pump:

1. Unit shall be capable of incorporating a field installed chilled liquid solution pump. (Space restricted)
2. Unit shall have provisions to allow for chilled liquid solution piping to the exterior of the cabinet.
3. No line length limitations from the outdoor chiller to the indoor fan coils.

G. Evaporator:

1. Evaporator shall have two independent refrigerant circuits.
2. Rated for a refrigerant side working pressure of 450 psig and a maximum water side working pressure of 60 psig.
3. Single pass, ANSI type 316 stainless steel, brazed plate construction.
4. Externally insulated with closed cell, elastomeric foam. (ASTM518)

H. Condenser:

1. Condenser coil shall be air-cooled with integral subcooler.
2. Two independent refrigerant circuits.
3. Constructed of rifled copper tubing mechanically bonded to aluminum fins.
4. Cleaned and dehydrated.
5. Factory leak tested to 450 psig.

I. Refrigerant Circuits:

1. Each circuit shall contain a sight glass, liquid line filter, thermal expansion valve, refrigerant charge of R407c and POE compressor oil.
2. All refrigerant is contained in the outdoor chiller with no potential of accidental discharges into occupied spaces.
3. Chiller contains less than 1.5 pounds of refrigerant per ton of cooling to comply with LEED guidelines.

Part 3-Controls and Safeties**3.01 Controls**

- A. Chiller shall be completely factory wired and tested.
- B. Capacity control shall be based on leaving chilled liquid solution temperature.
 1. Temperature accuracy shall be $\pm 1.0^{\circ}\text{F}$.
 2. Controls shall be capable of staging the two compressors.
- C. Controls shall include the following components.
 1. 24vac transformer to serve all controllers relays and control components.
 2. Microprocessor based liquid solution temperature controller.
 3. Leaving water temperature thermistor.
 4. Pump bypass timer.
 5. Compressor recycle timer.
 6. Optional fan cycling control for low ambient operation.
 7. Chilled liquid solution flow switch.
 8. Building Management Systems can be field supplied and incorporated into factory controls.

3.02 Safeties

- A. Unit shall be equipped with thermistors and all necessary components in conjunction with the control system to provide the following protectants.
 1. Low refrigerant pressure.
 2. High refrigerant pressure.
 3. Low chilled liquid solution temperature.
 4. Low chilled liquid solution flow.
 5. Thermal overload.
 6. Short cycling.

Part 4-Operating Characteristics:**4.01 Temperatures**

- A. Unit shall be capable of starting and running at outdoor temperatures from 55°F to 120°F.
- B. Optional Low Ambient Kit shall allow starting and running at outdoor temperatures to -20°F. A field supplied and installed crank case heater must be used when operating at these temperatures.
- C. Unit shall be capable of starting up with a maximum 80°F and a sustained 70°F entering fluid solution temperature to the evaporator.
- D. Minimum 10% Glycol solution is required. For outdoor temperatures below 32°F, reference MAC Glycol Solution Data table.

4.02 Electrical Requirements

- A. Primary electrical power supply shall enter the unit at a single location.
- B. Electrical power supply shall be rated to withstand 120°F operating ambient temperature.
- C. Units shall be available in 1 or 3-phase power at the voltages shown in the equipment electrical data.
- D. Control points shall be accessed through terminal block.

MAC120-03-N-407 Product Specifications

Physical Data										
Model Number	Condenser Coil				Chiller				Weight (lbs)	
	Height (in)	Length (in)	Copper Tubing Diameter (in)	Coil Rows	Height (in)	Length (in)	Width (in)	Refrigerant R407c	Net	Shipping
MAC120-03-N-407	52.5	48	3/8	3	60	58.25	25.25	104 oz x 2	650	700

Electrical Data								
Model Number	Volts/ Phase/ Hertz	Compressor (Qty 2)		Condenser Fan Motor (Qty 2)		Fuse or HACR Circuit Breaker		
		(RLA)	(LRA)	(RLA)	(RPM)	Minimum Amps	Maximum Amps	
MAC120-03-N-407	380/460-3-50/60	10 x 2	75 x 2	1.6 x 2	900	25.70 "See note 1"	35 "See note 1"	

Note:

- MAC120-03-N-407 has one independent line voltage termination.

Copper Wire Size (1% Voltage Drop)									
Supply Wire Length in Feet	200	6	4	4	4	3	3	2	2
	150	8	6	6	4	4	4	3	3
	100	10	8	8	6	6	6	4	4
	50	14	12	10	10	8	8	6	6
		15	20	25	30	35	40	45	50
Supply Circuit Ampacity									

Compressor	Copeland Scroll
Refrigerant	R407c
Heat Exchanger	Brazed Plate
Max Flow Rate	28.8 gpm
Min Flow Rate	18 gpm
Supply Water Temp	44°
Return Water Temp	54°
Minimum System Solution Content	50 Gallons
Expansion Tank Size	3% of Total System
Water Connections	1 3/8" OD Supply & Return
Internal Pressure Drop	18 ft of head

Multi aqua chillers are designed to operate exclusively with R407c refrigerant in a self-contained, pre-charged refrigerant system. Do not access the closed refrigerant circuit for any reason other than after-sale, after installation component replacement. Routine maintenance and service is to be performed by qualified personnel only.

MAC120-03-N-407 Product Specifications

MAC120 Capacity / Watts / EER* / COP**					
	Outdoor Air °F				
	82	95	100	105	110
TONS	9.4	9.0	8.8	8.7	8.7
KILOWATTS	10.9	11.5	11.5	12.1	12.4
EER	10.35	9.39	9.18	8.63	8.42
COP	3.03	2.80	2.69	2.53	2.47

* Refrigerant system performance only, pump data not included.

**The following equation was used to calculate COP values other than ARI conditions: COP = EER x .2928

MAC120 Glycol Solution Data				
Propylene Glycol %	Water Flow	Capacity	Min. Ambient Temp	GPM Adjustment= 100% Capacity
10%	x 1.020	x 0.99	26°F	x 1.01
20%	x 1.028	x 0.98	18°F	x 1.03
30%	x 1.036	x 0.98	8°F	x 1.07
40%	x 1.048	x 0.97	-7°F	x 1.11
50%	x 1.057	x 0.96	-29°F	x 1.16

Example: 30% glycol solution.
 Maximum Flow Rate = 12gpm x 1.036
 System capacity x .98
***Use Propylene Glycol Only**

Important

If the outside temperature is expected to fall below freezing (32°F) in the area the Multiaqua chiller is to be installed; the installer must take the following precautions. **Failure to do so will void the warranty. To not engage in cold ambient mitigation will result in the failure of components such as the heat exchanger, piping, circulating pump, etc... and or property damage.**

- Keep the liquid solution at a minimum of 10% percent Propylene Glycol even in areas where there is no danger of freezing.
- The percentage amount of glycol recommended is dependent on the expected ambient temperatures and the solution makeup recommendation of the glycol manufacturer. Refer to the MAC120 Glycol Solution Data table above.
- Ensure the system circulating pump is in a constant energized mode to keep a continuous circulation of liquid solution.

The Multiaqua chiller is a self-contained air-cooled condenser, coupled with an insulated brazed plate heat exchanger (evaporator). The system utilizes a scroll compressor to circulate refrigerant between the condenser and heat exchanger. The refrigerant is metered into the heat exchanger with a thermal expansion valve. Protecting the system are high and low pressure switches as well as a pump flow switch. Liquid solution (water and Propylene Glycol; minimum 10 % is required) is circulated through the heat exchanger by an externally mounted pump. The liquid solution flows through the heat exchanger to the system supply piping and on to the air handlers.

Low ambient kits are available for operating ambient temperatures down to -20 degrees Fahrenheit. A field supplied and installed crankcase heater must be installed when operating at these temperatures. The low ambient kits consist of an ICM 325 (+) ICM (175) for single and three phase 208/230 vac chillers. For the three phase 380/460 vac chillers a pressure activated fan control is used.

These specifications are subject to change without notice.

MAC120-03-N-407 Cooling Performance Data

MAC120 CAPACITIES with 0% Glycol										
LWT (°F)	ENTERING AIR TEMPERATURE (°F)									
	82		95		100		105		110	
	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM
35	7.9	28.8	7.6	28.8	7.4	28.8	7.3	28.8	7.1	28.8
40	8.8		8.4		8.2		8.1		8.1	
42	9.1		8.7		8.5		8.4		8.4	
44	9.4		9.0		8.8		8.7		8.7	
45	9.6		9.2		9.0		8.8		8.8	
46	9.7		9.3		9.1		9.0		9.0	
48	10.1		9.7		9.4		9.3		9.3	
50	10.4		10.0		9.7		9.6		9.6	
55	11.3		10.9		10.5		10.4		10.3	
60	12.3		11.8		11.4		11.2		11.1	

MAC120 CAPACITIES with 10% Glycol										
LWT (°F)	ENTERING AIR TEMPERATURE (°F)									
	82		95		100		105		110	
	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM
35	7.8	28.8	7.5	28.8	7.3	28.8	7.2	28.8	7.0	28.8
40	8.7		8.3		8.1		8.0		8.0	
42	9.0		8.6		8.4		8.3		8.3	
44	9.3		8.9		8.7		8.6		8.6	
45	8.5		9.1		8.9		8.7		8.7	
46	9.6		9.2		9.0		8.9		8.9	
48	10.0		9.6		9.3		9.2		9.2	
50	10.3		9.9		9.6		9.5		9.5	
55	11.2		10.7		10.4		10.3		10.2	
60	12.1		11.6		11.2		11.0		10.9	

MAC120 CAPACITIES with 20% Glycol										
LWT (°F)	ENTERING AIR TEMPERATURE (°F)									
	82		95		100		105		110	
	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM
35	7.7	28.8	7.4	28.8	7.2	28.8	7.1	28.8	6.9	28.8
40	8.6		8.2		8.0		7.9		7.9	
42	8.9		8.5		8.3		8.2		8.2	
44	9.2		8.8		8.6		8.5		8.5	
45	9.4		9.0		8.8		8.6		8.6	
46	9.5		9.1		8.9		8.8		8.8	
48	9.9		9.5		9.2		9.1		9.1	
50	10.1		9.8		9.5		9.4		9.4	
55	11.1		10.6		10.2		10.1		10.0	
60	12.0		11.5		11.1		10.9		10.8	

These specifications are subject to change without notice.

MAC120-03-N-407 Cooling Performance Data

MAC120 CAPACITIES with 30% Glycol										
LWT (°F)	ENTERING AIR TEMPERATURE (°F)									
	82		95		100		105		110	
	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM
35	7.7	28.8	7.4	28.8	7.2	28.8	7.1	28.8	6.9	28.8
40	8.5		8.1		8.0		7.9		7.9	
42	8.8		8.4		8.2		8.1		8.1	
44	9.1		8.7		8.5		8.4		8.4	
45	9.3		8.9		8.7		8.5		8.5	
46	9.4		9.0		8.8		8.7		8.7	
48	9.8		9.4		9.1		9.0		9.0	
50	10.1		9.7		9.4		9.3		9.3	
55	11.0		10.6		10.2		10.1		10.0	
60	11.9		11.5		11.1		10.9		10.8	

MAC120 CAPACITIES with 40% Glycol										
LWT (°F)	ENTERING AIR TEMPERATURE (°F)									
	82		95		100		105		110	
	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM
35	7.6	28.8	7.3	28.8	7.1	28.8	7.0	28.8	6.8	28.8
40	8.5		8.1		7.9		7.8		7.8	
42	8.8		8.4		8.2		8.1		8.1	
44	9.1		8.7		8.5		8.4		8.4	
45	9.3		8.9		8.7		8.5		8.5	
46	9.4		9.0		8.8		8.7		8.7	
48	9.8		9.4		9.1		9.0		9.0	
50	10.0		9.7		9.4		9.3		9.3	
55	10.9		10.5		10.1		10.0		9.9	
60	11.9		11.4		11.0		10.8		10.7	


MAC120 CAPACITIES with 50% Glycol										
LWT (°F)	ENTERING AIR TEMPERATURE (°F)									
	82		95		100		105		110	
	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM	TONS	GPM
35	7.5	28.8	7.3	28.8	7.1	28.8	7.0	28.8	6.8	28.8
40	8.4		8.0		7.8		7.7		7.7	
42	8.7		8.3		8.1		8.0		8.0	
44	9.0		8.6		8.4		8.3		8.3	
45	9.2		8.8		8.6		8.4		8.4	
46	9.3		8.9		8.7		8.6		8.6	
48	9.7		9.3		9.0		8.9		8.9	
50	9.9		9.6		9.3		9.2		9.2	
55	10.8		10.4		10.0		9.9		9.8	
60	11.8		11.3		10.9		10.7		10.6	

These specifications are subject to change without notice.


MAC120-03-N-407 Ladder Wiring Diagram

380/460-3-50/60


380-460-3-50/60
VAC

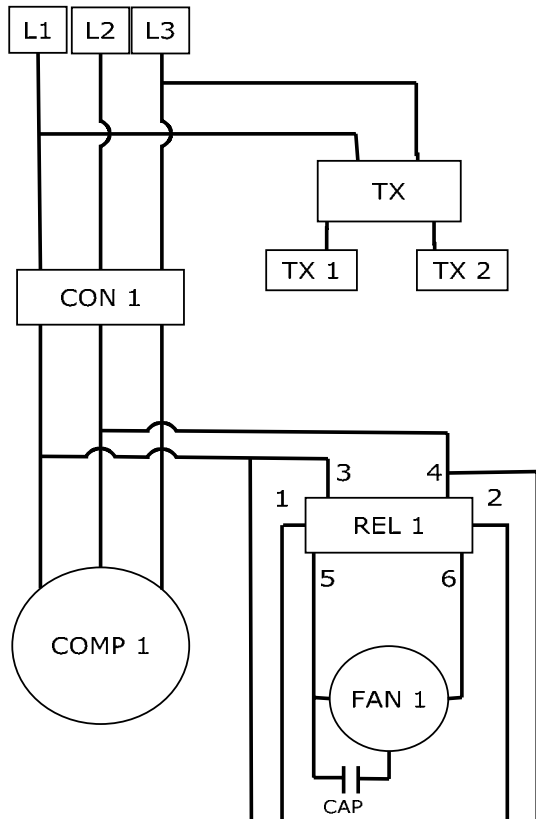

380/460-3-50/60
VAC

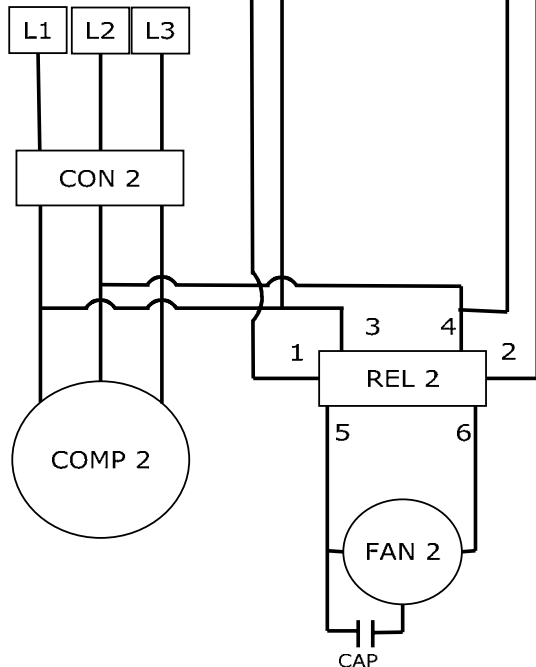


24 VAC

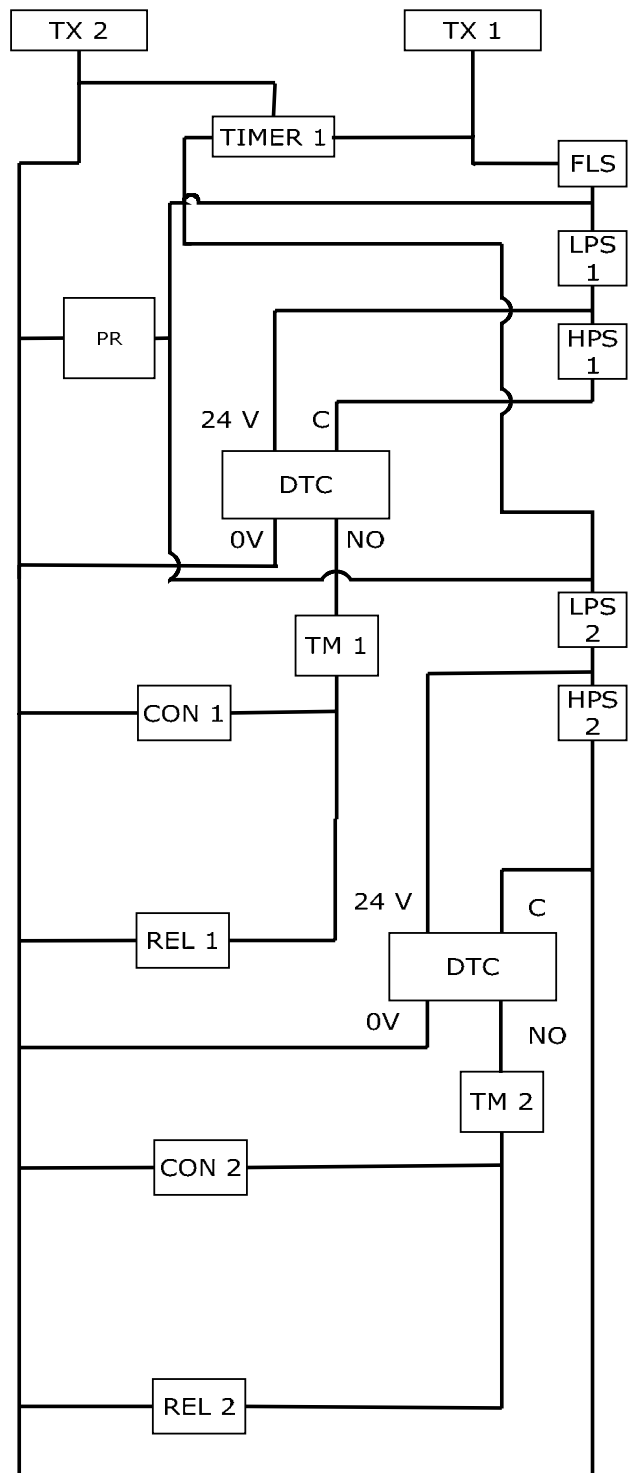

MAC120-03-N-407 Wiring Diagram

380/460-3-50/60

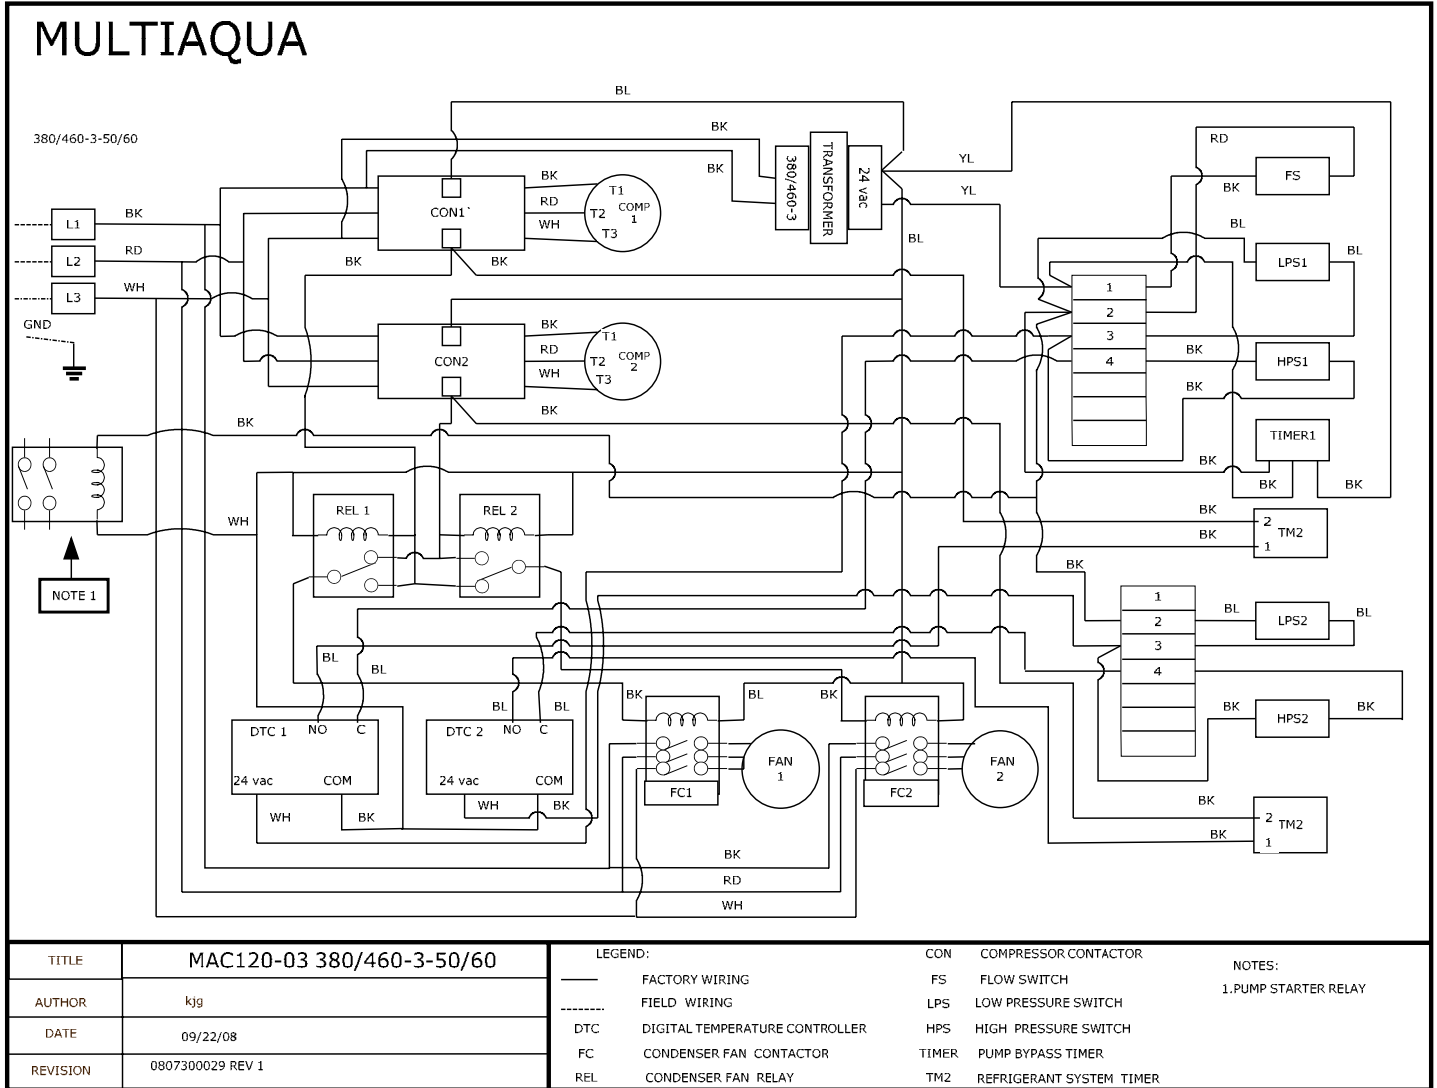


TITLE	MAC120-03 380/460-3-50/60
AUTHOR	kjg
DATE	09/22/08
REVISION	0807300029 REV 1

LEGEND:	
—	FACTORY WIRING
----	FIELD WIRING
DTC	DIGITAL TEMPERATURE CONTROLLER
FC	CONDENSER FAN CONTACTOR
REL	CONDENSER FAN RELAY

CON	COMPRESSOR CONTACTOR	NOTES:
FS	FLOW SWITCH	1.PUMP STARTER RELAY
LPS	LOW PRESSURE SWITCH	
HPS	HIGH PRESSURE SWITCH	
TIMER	PUMP BYPASS TIMER	
TM2	REFRIGERANT SYSTEM TIMER	

MAC120-03-N-407 CERTIFIED DRAWING

MAC120 Certified Drawing
 Drawing # 0907400081

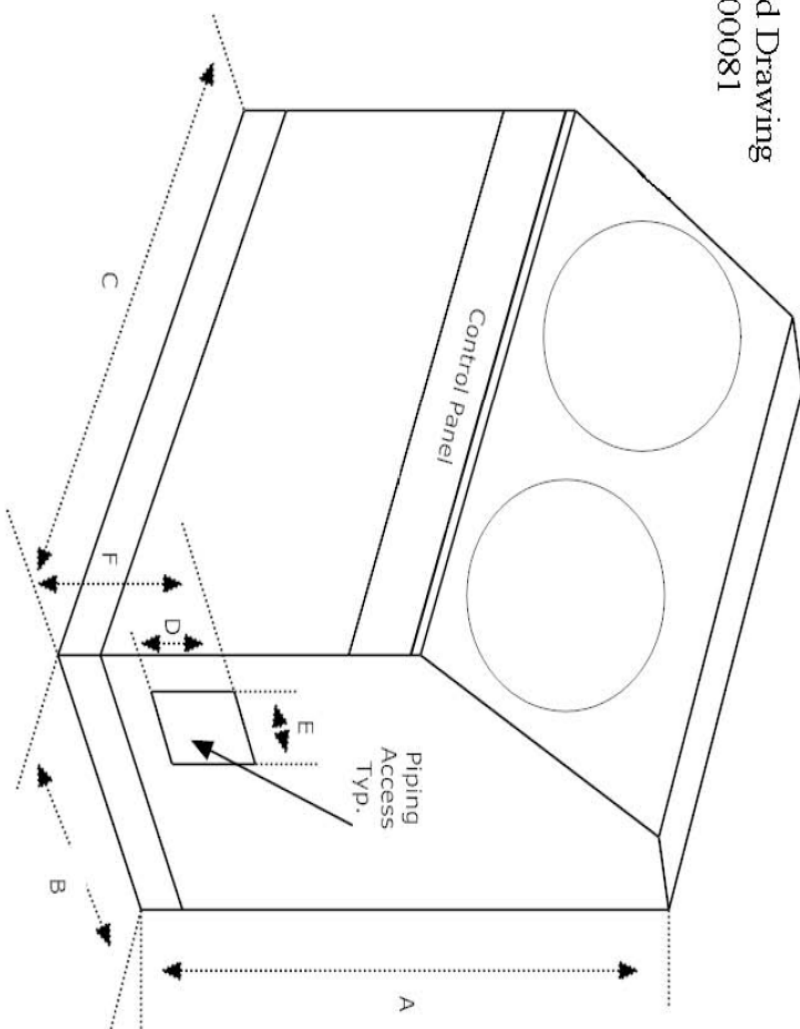

MAC120

MODEL	A	B	C	D	E	F
MAC120-1	60.00"	25.25"	58.25"	5.00"	4.25"	15.00"
MAC120-2	60.00"	25.25"	58.25"	5.00"	4.25"	15.00"
MAC120-3	60.00"	25.25"	58.25"	5.00"	4.25"	15.00"